

Episcopal Church of NH  
March 2015 Cuba Mission


### Design Modifications in Red

Compare with diagram  
in User's Manual

OUTLET



Electrical connections are not shown,  
and are unchanged from the manufacturer's diagram.

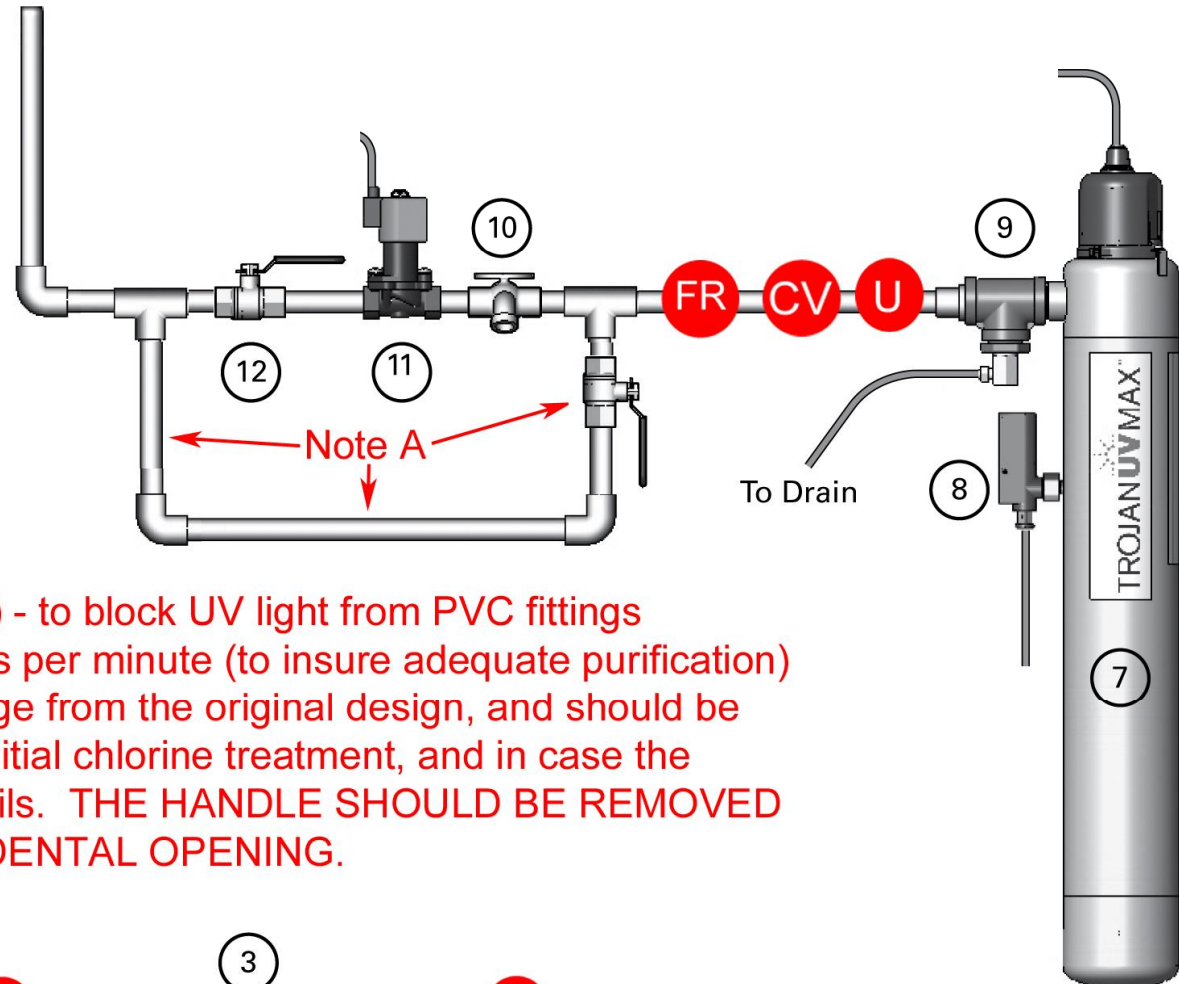

To Drain

U = Union

G = Pressure Gauge

CV = Check Valve (swing type) - to block UV light from PVC fittings

FR = Flow Restrictor - 6 gallons per minute (to insure adequate purification)

Note A: This bypass is a change from the original design, and should be opened only for the initial chlorine treatment, and in case the solenoid valve (11) fails. **THE HANDLE SHOULD BE REMOVED TO PREVENT ACCIDENTAL OPENING.**

INLET

